
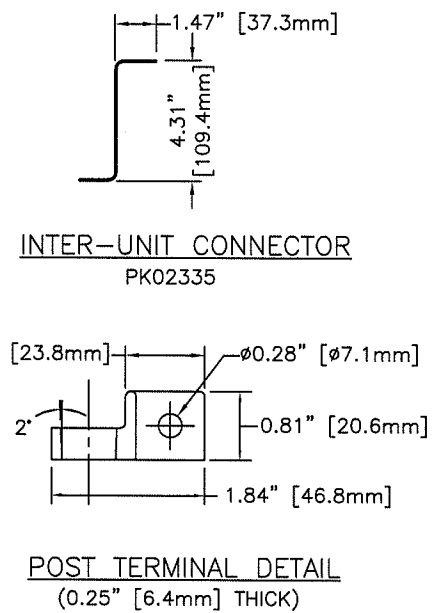


NOTICE: THIS PRINT AND THE INFORMATION SHOWN THEREON IS THE PROPERTY OF C&D TECHNOLOGIES, INC. AND IS BEING FURNISHED AS A CONFIDENTIAL DISCLOSURE. IT MAY NOT BE DELIVERED TO OTHERS NOR REPRODUCED FOR THE GENERAL CIRCULATION WITHOUT THE WRITTEN APPROVAL OF C&D TECHNOLOGIES, INC.

REVISION HISTORY						
ZONE	REV	DESCRIPTION	ECN#	REV'D	CHK'D	DATE

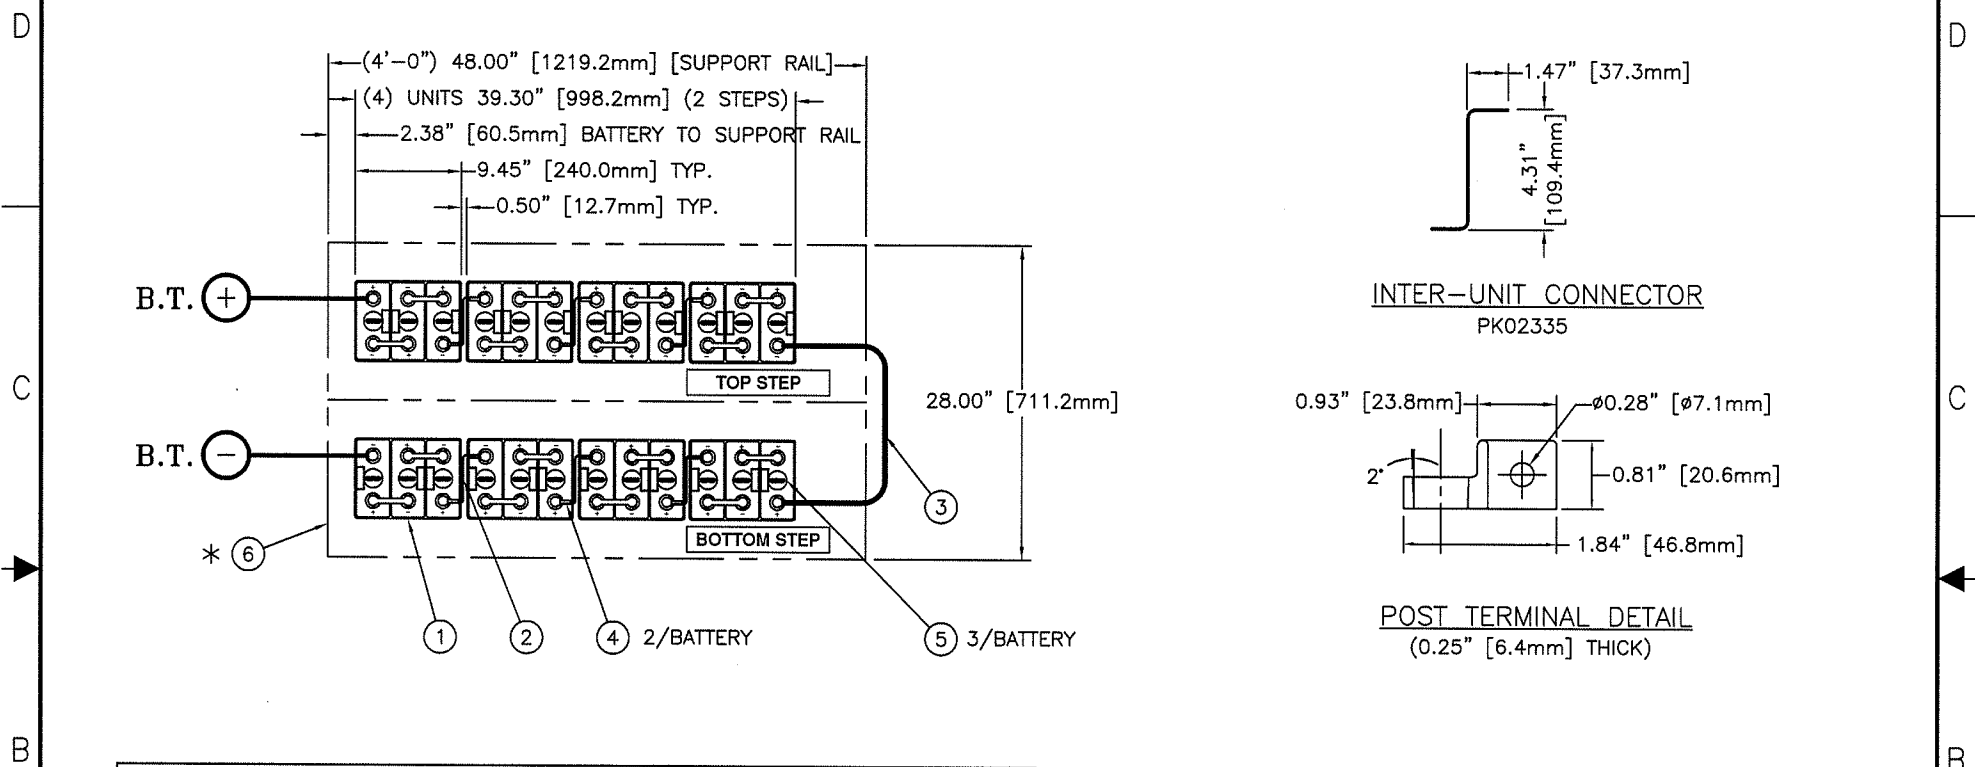

48 VDC BATTERY SYSTEM			
ITEM	QTY.	PART NO.	DESCRIPTION
1A	8	CW06321	3DCU-7 BATTERY UNIT (J08982)
1B	8	CW06488	3DCU-9 BATTERY UNIT (J08982)
2	6	PK02335	INTER-UNIT CONNECTOR
3	1	RA02178-32	INTER-STEP CONNECTION #1 CABLE 32" LONG
4	16	PB00253	BOLT ASS'Y, LEAD/BRASS (1) PB00252 CAST TERMINAL NUT 1/4X20 (1) PB00250 CAST SMALL POWER BOLT
5	24	PV00483	FLAME ARRESTOR ASSY "D"
* ADDITIONAL ITEMS			
6A	1	RDB0703-04P	RACK ASSEMBLY, 2-STEP (M11469)
6B	1	RDB0703-04EP1P	RACK ASSEMBLY, 2-STEP EP1 (M11470)
6C	1	RDB0703-04EP2P	RACK ASSEMBLY, 2-STEP EP2 (M11471)
7	1	SP32052L	SPILL CONTAINMENT

- NOTES :
1. ALL DIMENSIONS ARE REFERENCE.
  2. ITEMS 2, 3, 4 & 5 ARE SUPPLIED IN ACCESSORY KIT, RE02519.
  3. RACK AND SPILL CONTAINMENT ARE ADDITIONAL. THEY MUST BE ORDERED AS SEPARATE ITEMS.
  4. C&D SEISMIC RACKS REQUIRE BATTERY SPACERS, PART NO. RE01640, QUANTITY 6.
  5. REGARDING SPILL CONTAINMENT, PART NUMBER REFLECTS OUTSIDE DIMENSIONS OF SPILL CONTAINMENT BARRIERS, INSIDE DIMENSIONS ARE "-2".

\* ADDITIONAL ITEMS MUST BE ORDERED SEPARATELY

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES. TOLERANCES ARE:		DRAWN: S. S. F. / J. K. S.	DATE: 4/11/07	<b>C&amp;D TECHNOLOGIES, INC.</b> 1400 UNION MEETING ROAD, BLUE BELL, PA 19422-0858 www.cdtechno.com
X	XX	XXX	FEELS	
THIRD ANGLE PROJECTION		CHECKED: [Signature]	DATE: 1/29/09	TITLE: BATTERY ARRANGEMENT - 48 VDC 2-STEP RACK, (8) 3DCU-7 & 9 UNITS
APPROVED: [Signature]		APPROVED: [Signature]		SIZE: C CASE CODE: RE02519-2S DRAWING NUMBER: RE02519-2S REVISION: 0
MATERIAL:		FILE: RE02519A-2S		SCALE N.T.S. SHEET 1 OF 2