
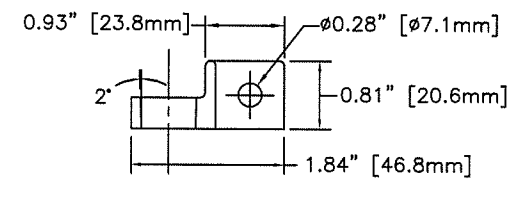
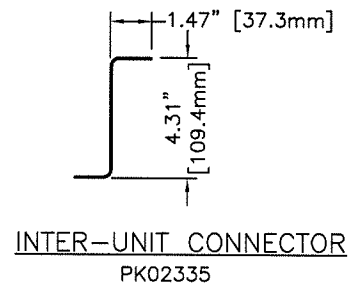


NOTICE: THIS PRINT AND THE INFORMATION SHOWN THEREON IS THE PROPERTY OF C&D TECHNOLOGIES, INC. AND IS BEING FURNISHED AS A CONFIDENTIAL DISCLOSURE. IT MAY NOT BE DELIVERED TO OTHERS NOR REPRODUCED FOR THE GENERAL CIRCULATION WITHOUT THE WRITTEN APPROVAL OF C&D TECHNOLOGIES, INC.

REVISION HISTORY						
ZONE	REV	DESCRIPTION	ECN#	REV'D	CHK'D	DATE

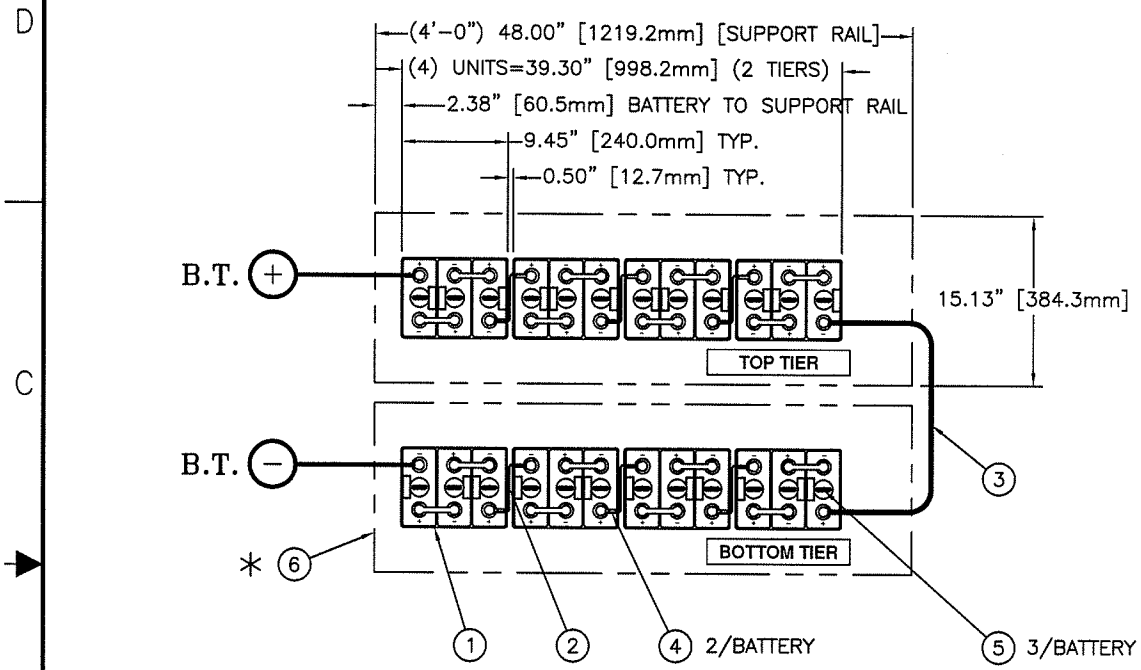

48 VDC BATTERY SYSTEM			
ITEM	QTY.	PART NO.	DESCRIPTION
1A	8	CW06321	3DCU-7 BATTERY UNIT (J08982)
1B	8	CW06488	3DCU-9 BATTERY UNIT (J08982)
2	6	PK02335	INTER-UNIT CONNECTOR
3	1	RA02178-32	INTER-TIER CONNECTION #1 CABLE 32" LONG
4	16	PB00253	BOLT ASS'Y, LEAD/BRASS (1) PB00252 CAST TERMINAL NUT 1/4X20 (1) PB00250 CAST SMALL POWER BOLT
5	24	PV00483	FLAME ARRESTOR ASSY "D"

* ADDITIONAL ITEMS			
ITEM	QTY.	PART NO.	DESCRIPTION
6A	1	RDB0701-04P	RACK ASSEMBLY, 2-TIER (M11463)
6B	1	RDB0701-04EP1P	RACK ASSEMBLY, 2-TIER EP1 (M11464)
6C	1	RDB0701-04EP2P	RACK ASSEMBLY, 2-TIER EP2 (M11465)
7	1	SP20052L	SPILL CONTAINMENT

\* ADDITIONAL ITEMS MUST BE ORDERED SEPARATELY

NOTES :

1. ALL DIMENSIONS ARE REFERENCE.
2. ITEMS 2, 3, 4 & 5 ARE SUPPLIED IN ACCESSORY KIT, RE02519.
3. RACK AND SPILL CONTAINMENT ARE ADDITIONAL. THEY MUST BE ORDERED AS SEPARATE ITEMS.
4. C&D SEISMIC RACKS REQUIRE BATTERY SPACERS, PART NO. RE01640, QUANTITY 6.
5. REGARDING SPILL CONTAINMENT, PART NUMBER REFLECTS OUTSIDE DIMENSIONS OF SPILL CONTAINMENT BARRIERS, INSIDE DIMENSIONS ARE -2".

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES & TOLERANCES ARE:		DATE	ALL SHEETS ARE THE SAME REVISION STATUS	
FRAMES	±0.005	4/11/07	 1400 UNION MEETING ROAD, BLUE BELL, PA 19422-0858 www.cdtechno.com	
KEYHOLES	±0.005	1/29/09		
THIRD ANGLE PROJECTION		APPROVED	TITLE: BATTERY ARRANGEMENT - 48 VDC 2-TIER RACK, (8) 3DCU-7 & 9 UNITS	
MATERIAL			SIZE	REVISION
			C	0
		FILE: RE02519A-2T	SCALE N.T.S.	SHEET 1 OF 2