
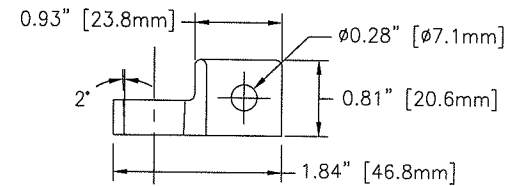


NOTICE:
THIS PRINT AND THE INFORMATION SHOWN THEREON IS THE PROPERTY OF CAD TECHNOLOGIES, INC. AND IS BEING
FURNISHED AS A CONFIDENTIAL DISCLOSURE. IT MAY NOT BE DELIVERED TO OTHERS NOR REPRODUCED FOR THE
GENERAL CIRCULATION WITHOUT THE WRITTEN APPROVAL OF CAD TECHNOLOGIES, INC.

REVISION HISTORY							
ZONE	REV	DESCRIPTION	ECN#	REV'D	CHK'D	DATE	APPROVED

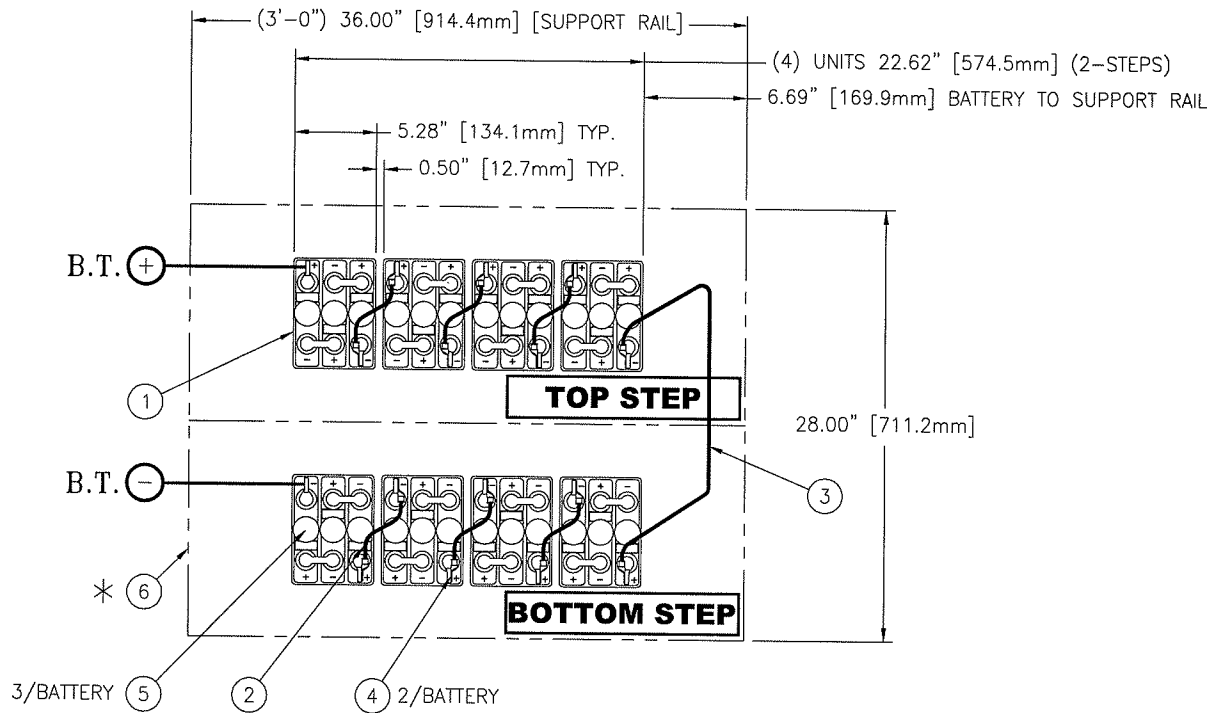

POST TERMINAL DETAIL
(0.25" [6.4mm] THICK)

48 VDC BATTERY SYSTEM			
ITEM	QTY.	PART NO.	DESCRIPTION
1A	8	CW06645	3DCU-3 BATTERY UNIT (J08980)
1B	8	CW06480	3DCU-5 BATTERY UNIT (J08980)
2	6	RA02176-10.5	INTER-UNIT CONNECTOR #4 CABLE 10.5" LONG
3	1	RA02176-32	INTER-STEP CONNECTION #4 CABLE 32" LONG
4	16	PB00253	BOLT ASS'Y, LEAD/BRASS (1) PB00252 CAST TERMINAL NUT 1/4X20 (1) PB00250 CAST SMALL POWER BOLT
5	24	PV00483	FLAME ARRESTOR ASSY "D"
* ADDITIONAL ITEMS			
6A	1	RDB0703-03P	RACK ASSEMBLY, 2-STEP (M11469)
6B	1	RDB0703-03EP1P	RACK ASSEMBLY, 2-STEP EP1 (M11470)
6C	1	RDB0703-03EP2P	RACK ASSEMBLY, 2-STEP EP2 (M11471)
7	1	SP32040L	SPILL CONTAINMENT

* ADDITIONAL ITEMS MUST BE ORDERED SEPARATELY

NOTES:

- ALL DIMENSIONS ARE REFERENCE.
- ITEMS 2, 3, 4 & 5 ARE SUPPLIED IN ACCESSORY KIT, RE02518.
- RACK AND SPILL CONTAINMENT ARE ADDITIONAL. THEY MUST BE ORDERED AS SEPARATE ITEMS.
- C&D SEISMIC RACKS REQUIRE BATTERY SPACERS, PART NO. RE01640, QUANTITY 6.
- REGARDING SPILL CONTAINMENT, PART NUMBER REFLECTS OUTSIDE DIMENSIONS OF SPILL CONTAINMENT BARRIERS, INSIDE DIMENSIONS ARE -2".

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES. ± TOLERANCES ON: DECIMALS ANGLES	DRAWN G.R. KUIJEL	DATE 4/10/07
X XX XXX	CHECKED BY [Signature]	4/27/09
THIRD ANGLE PROJECTION	APPROVED BY [Signature]	4/27/07
MATERIAL	APPROVED	

ALL SHEETS ARE THE SAME REVISION STATUS			
CAD TECHNOLOGIES, INC.			
1400 UNION MEETING ROAD, BLUE BELL, PA 19422-0858 www.cadtechno.com			
TITLE BATTERY ARRANGEMENT - 48 VDC 2-STEP RACK, (8) 3DCU-3 & 5			
SIZE C	CAGE CODE	DRAWING NUMBER RE02518-2S	REVISION 0
SCALE	SHEET 1 OF 1		12/2000

FILE: RE02518-2S