
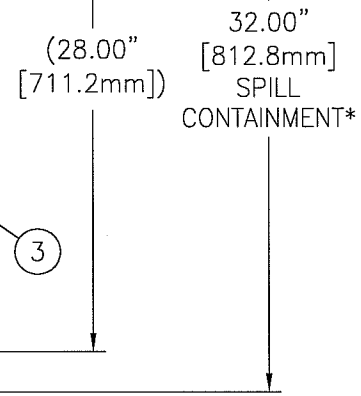
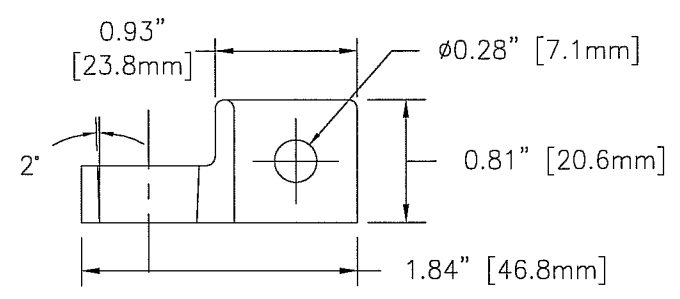


NOTICE: THIS PRINT AND THE INFORMATION SHOWN THEREON IS THE PROPERTY OF C&D TECHNOLOGIES, INC. AND IS BEING FURNISHED AS A CONFIDENTIAL DISCLOSURE. IT MAY NOT BE DELIVERED TO OTHERS NOR REPRODUCED FOR THE GENERAL CIRCULATION WITHOUT THE WRITTEN APPROVAL OF C&D TECHNOLOGIES, INC.

REVISION HISTORY							
ZONE	REV	DESCRIPTION	ECN#	REV'D	CHK'D	DATE	APPROVED

D
C
B
A

D
C
B
A

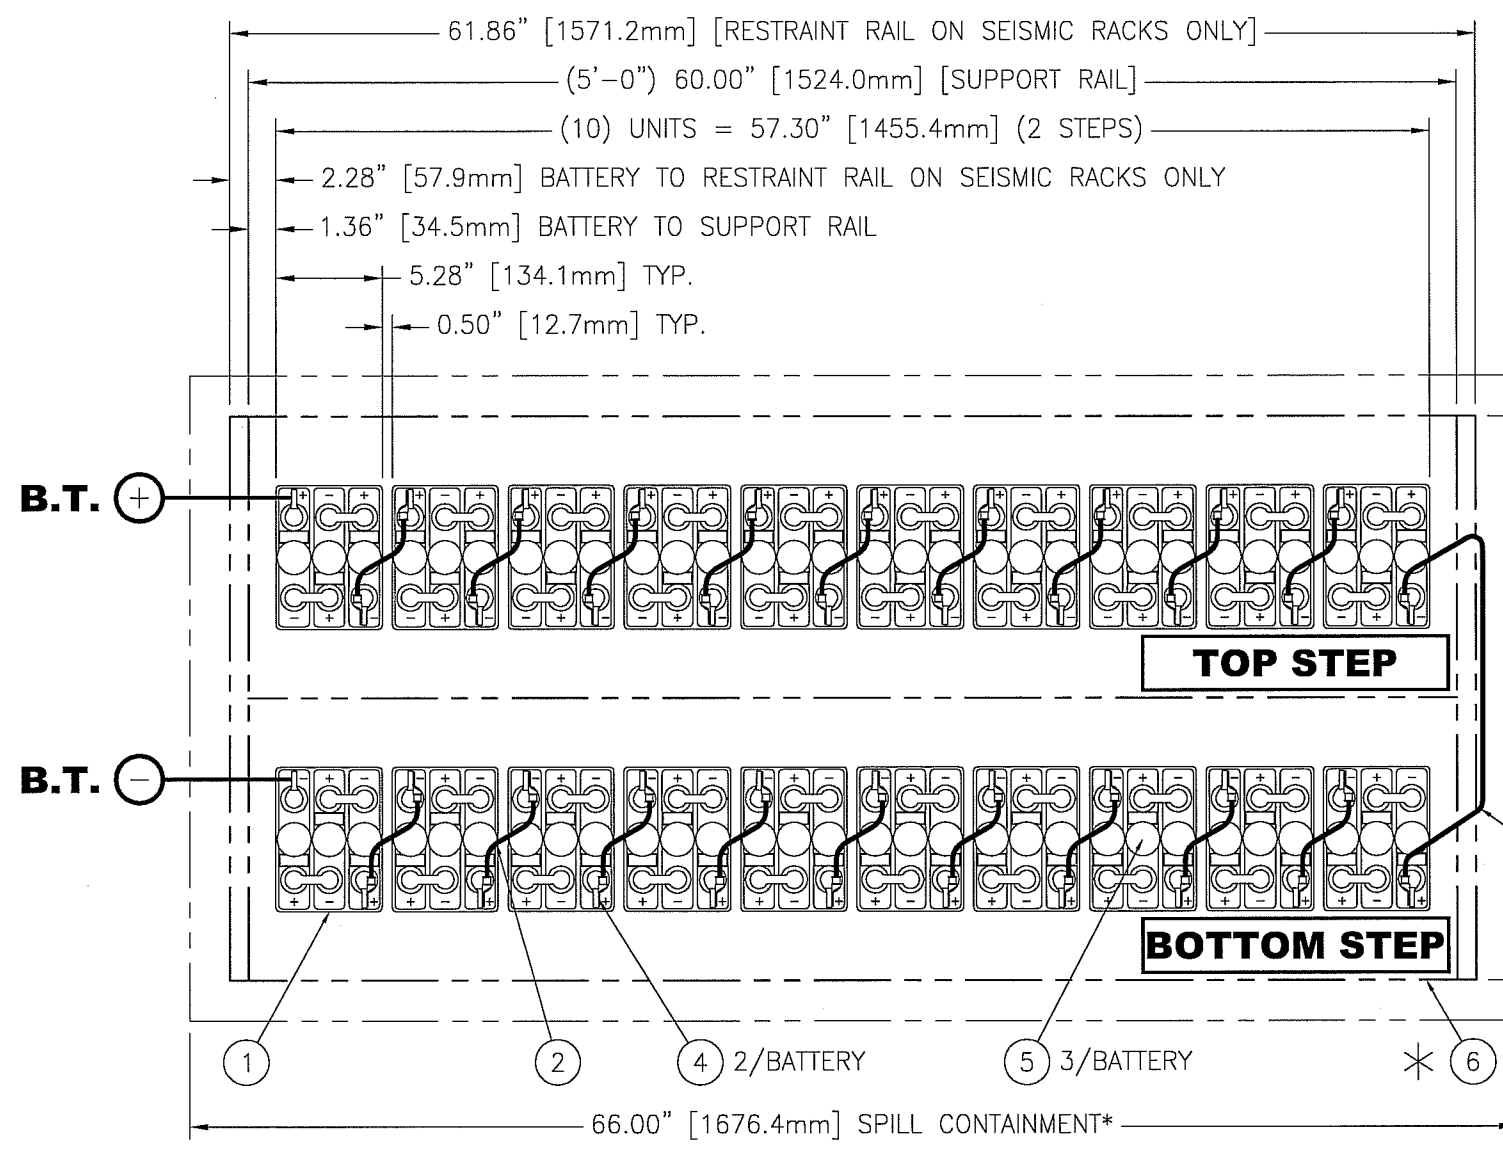

120 VDC BATTERY SYSTEM			
ITEM	QTY.	PART NO.	DESCRIPTION
1	20	CW06645	3DCU-3 BATTERY UNIT (J08980)
	20	CW06480	3DCU-5 BATTERY UNIT (J08980)
2	18	RA02176-10.5	INTER-UNIT CONNECTOR #4 CABLE 10.5" LONG
3	1	RA02176-32	INTER-STEP CONNECTION #4 CABLE 32" LONG
4	40	PB00253	BOLT ASS'Y, LEAD/BRASS, EACH CONSISTING OF: (1) PB00252 CAST TERMINAL NUT 1/4X20 (1) PB00250 CAST SMALL POWER BOLT
5	60	PV00483	FLAME ARRESTOR ASSY "D"
* ADDITIONAL ITEMS			
6	1	RDB0703-05P	RACK ASSEMBLY, 2-STEP (M11469)
	1	RDB0703-05EP1P	RACK ASSEMBLY, 2-STEP EP1 (M11470)
	1	RDB0703-05EP2P	RACK ASSEMBLY, 2-STEP EP2 (M11471)
7	1	SP32066L	SPILL CONTAINMENT

* ADDITIONAL ITEMS ARE TO BE ORDERED SEPARATELY

NOTES :

- ALL DIMENSIONS ARE REFERENCE.
- ITEMS 2, 3, 4 & 5 ARE SUPPLIED IN ACCESSORY KIT, RE02537.
- RACK AND SPILL CONTAINMENT ARE ADDITIONAL. THEY MUST BE ORDERED AS SEPARATE ITEMS.
- C&D SEISMIC RACKS REQUIRE BATTERY SPACERS, PART NO. RE01640, QUANTITY 18.
- REGARDING SPILL CONTAINMENT, PART NUMBER REFLECTS OUTSIDE DIMENSIONS OF SPILL CONTAINMENT'S BARRIERS, INSIDE DIMENSIONS ARE -2".

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES. ± TOLERANCES ON: DECIMALS ANGLES		DRAWN G.R.KUKEL	DATE 4/10/07	C&D TECHNOLOGIES, INC. 1400 UNION MEETING ROAD, BLUE BELL, PA 19422-0858 www.cdtechno.com TITLE BATTERY ARRANGEMENT - 120 VDC 2-STEP RACK, (20) 3DCU-3 & 5
X	XX	XXX		
THIRD ANGLE PROJECTION		APPROVED <i>K. Dawel</i> 7/2/08	APPROVED <i>J. Palatka</i> 7/2/08	SIZE C
MATERIAL		FILE: RE02537-2S		DRAWING NUMBER RE02537-2S
		SCALE		REVISION 0
		SHEET 1 OF 1		12/2000