
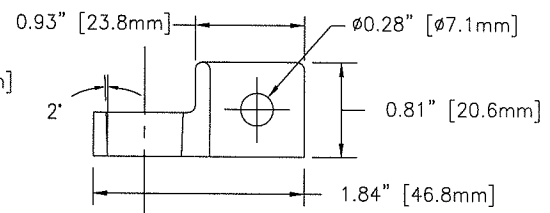


NOTICE: THIS PRINT AND THE INFORMATION SHOWN THEREON IS THE PROPERTY OF C&D TECHNOLOGIES, INC. AND IS BEING FURNISHED AS A CONFIDENTIAL DISCLOSURE. IT MAY NOT BE DELIVERED TO OTHERS NOR REPRODUCED FOR THE GENERAL CIRCULATION WITHOUT THE WRITTEN APPROVAL OF C&D TECHNOLOGIES, INC.

REVISION HISTORY							
ZONE	REV	DESCRIPTION	ECN#	REV'D	CHK'D	DATE	APPROVED

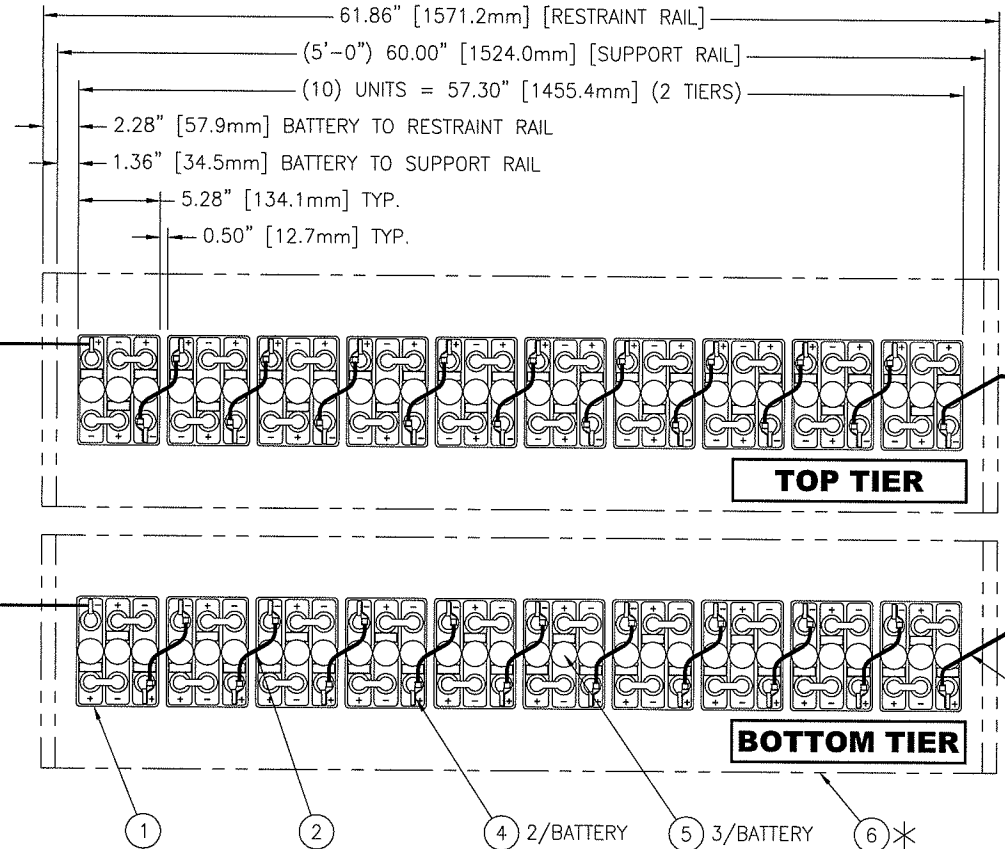

POST TERMINAL DETAIL
(0.25" [6.4mm] THICK)

NOTES :

1. ALL DIMENSIONS ARE REFERENCE.
2. ITEMS 2, 3, 4 & 5 ARE SUPPLIED IN ACCESSORY KIT, RE02537
3. RACK AND SPILL CONTAINMENT ARE ADDITIONAL. THEY MUST BE ORDERED AS SEPARATE ITEMS.
4. C&D SEISMIC RACKS REQUIRE BATTERY SPACERS, PART NO. RE01640, QUANTITY 18.
5. REGARDING SPILL CONTAINMENT, PART NUMBER REFLECTS OUTSIDE DIMENSIONS OF SPILL CONTAINMENT BARRIERS, INSIDE DIMENSIONS ARE -2".

120 VDC BATTERY SYSTEM			
ITEM	QTY.	PART NO.	DESCRIPTION
1A	20	CW06645	3DCU-3 BATTERY UNIT (J08980)
1B	20	CW06480	3DCU-5 BATTERY UNIT (J08980)
2	18	RA02176-10.5	INTER-UNIT CONNECTOR #4 CABLE 10.5" LONG
3	1	RA02176-32	INTER-TIER CONNECTION #4 CABLE 32" LONG
4	40	PB00253	BOLT ASS'Y, LEAD/BRASS (1) PB00252 CAST TERMINAL NUT 1/4X20 (1) PB00250 CAST SMALL POWER BOLT
5	60	PV00483	FLAME ARRESTOR ASSY "D"
* ADDITIONAL ITEMS			
6A	1	RDB0701-05P	RACK ASSEMBLY, 2-TIER (M11463)
6B	1	RDB0701-05EP1P	RACK ASSEMBLY, 2-TIER EP1 (M11464)
6C	1	RDB0701-05EP2P	RACK ASSEMBLY, 2-TIER EP2 (M11465)
7	1	SP20066L	SPILL CONTAINMENT

* ADDITIONAL ITEMS MUST BE ORDERED SEPARATELY

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES. TOLERANCES ON: X XX XXX ANGLES	DRAWN G.R. KUKEL	DATE 4/10/07
THIRD ANGLE PROJECTION	APPROVED <i>[Signature]</i> 1/27/09	APPROVED <i>[Signature]</i> 1/27/09
MATERIAL	FILE: RE02537-2T	SCALE

ALL SHEETS ARE THE SAME REVISION STATUS

C&D TECHNOLOGIES, INC.
1400 UNION MEETING ROAD, BLUE BELL, PA 19422-0858
www.cdtechno.com

TITLE
BATTERY ARRANGEMENT - 120 VDC
2-TIER RACK, (20) 3DCU-3 & 5

SIZE C	CAGE CODE	DRAWING NUMBER RE02537-2T	REVISION 0
SHEET 1		OF 1	